
The Upper San Joaquin Kaiser East Protection Project: Phase I

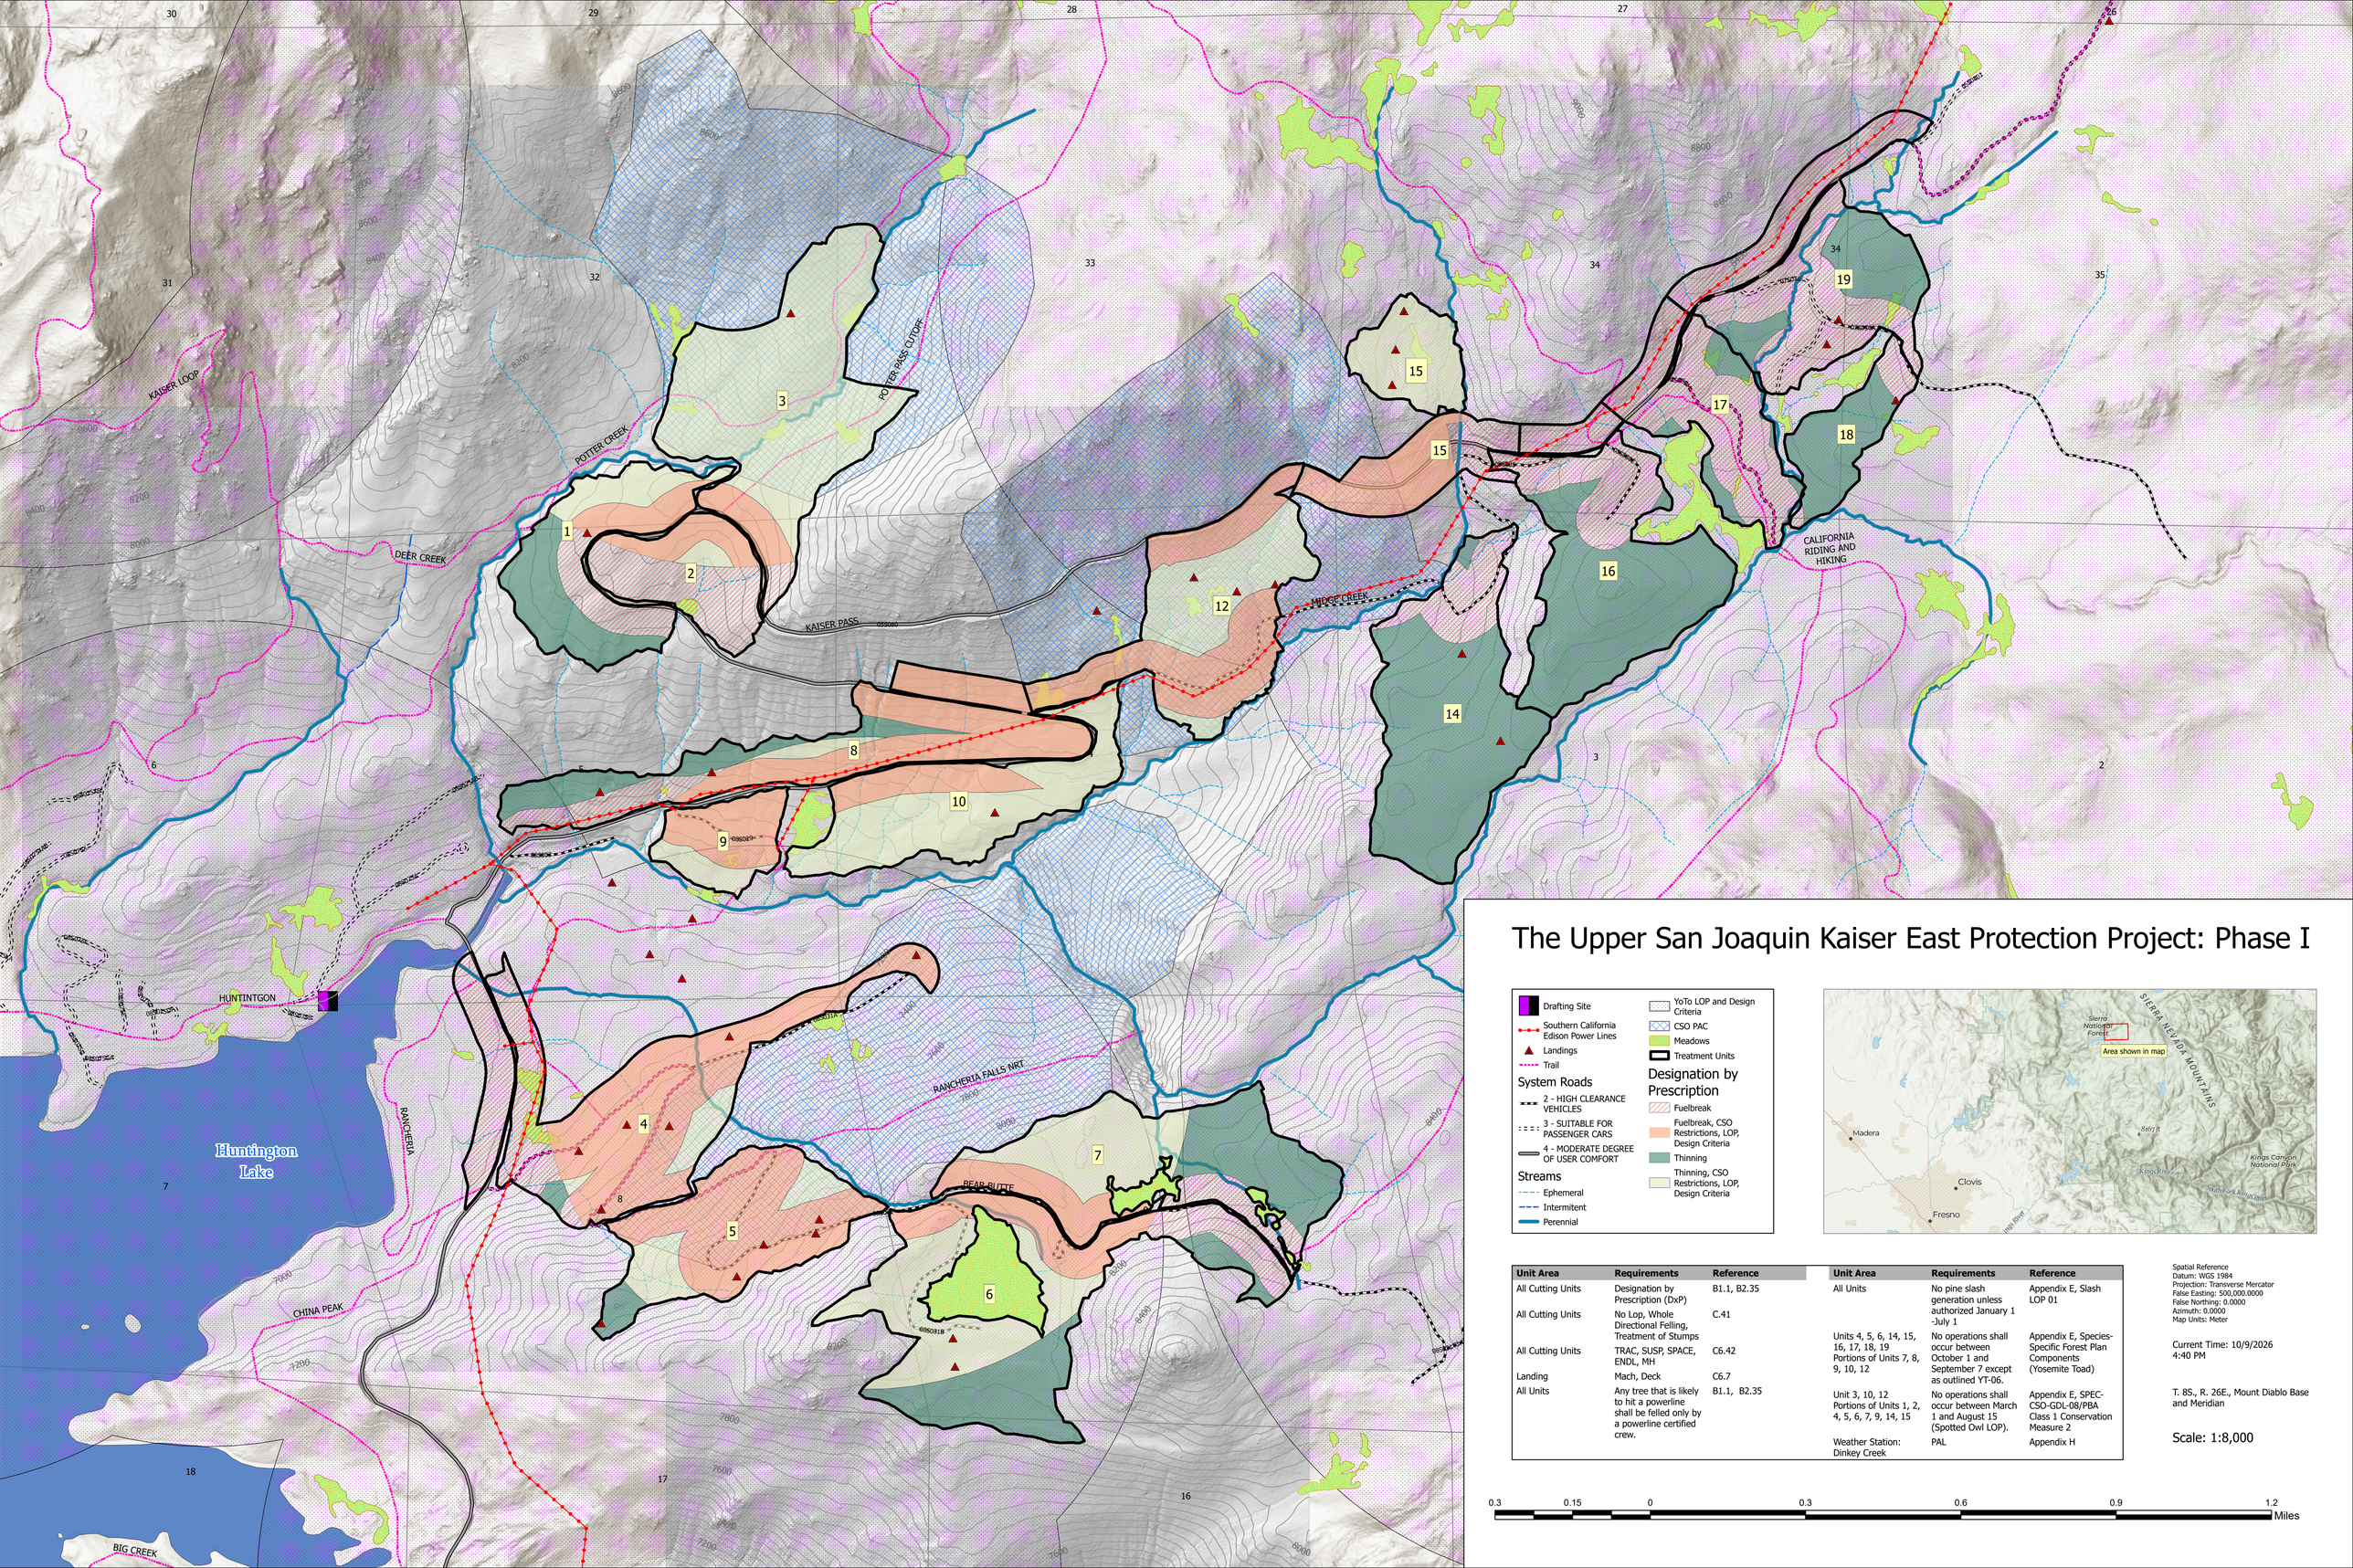

Drafting Site
Southern California Edison Power Lines
Landings
Trail

System Roads

2 - HIGH CLEARANCE VEHICLES
3 - SUITABLE FOR PASSENGER CARS
4 - MODERATE DEGREE OF USER COMFORT

Streams

Ephemeral
Intermitent
Perennial

YoTo LOP and Design Criteria
CSO PAC
Meadows
Treatment Units

Designation by Prescription

Fuelbreak
Fuelbreak, CSO Restrictions, LOP, Design Criteria
Thinning
Thinning, CSO Restrictions, LOP, Design Criteria

Unit Area	Requirements	Reference
All Cutting Units	Designation by Prescription (DxP)	B1.1, B2.35
All Cutting Units	No Lop, Whole Directional Felling, Treatment of Stumps	C.41
All Cutting Units	TRAC, SUSP, SPACE, ENDL, MH	C6.42
Landing	Mach, Deck	C6.7
All Units	Any tree that is likely to hit a powerline shall be felled only by a powerline certified crew.	B1.1, B2.35

Unit Area	Requirements	Reference
All Units	No pine slash generation unless authorized January 1 -July 1	Appendix E, Slash LOP 01
Units 4, 5, 6, 14, 15, 16, 17, 18, 19 Portions of Units 7, 8, 9, 10, 12	No operations shall occur between October 1 and September 7 except as outlined YT-06.	Appendix E, Species-Specific Forest Plan Components (Yosemite Toad)
Unit 3, 10, 12 Portions of Units 1, 2, 4, 5, 6, 7, 9, 14, 15	No operations shall occur between March 1 and August 15 (Spotted Owl LOP).	Appendix E, SPEC-CSO-GDL-08/PBA Class 1 Conservation Measure 2
Weather Station: Dinkey Creek	PAL	Appendix H

Spatial Reference
Datum: WGS 1984
Projection: Transverse Mercator
False Easting: 500,000.0000
False Northing: 0.0000
Azimuth: 0.0000
Map Units: Meter

Current Time: 10/9/2026
4:40 PM

T. 8S., R. 26E., Mount Diablo Base and Meridian

Scale: 1:8,000

0.3 0.15 0 0.3 0.6 0.9 1.2 Miles